



1	2	3	4	5	6	7	8	9	10	11	12	13
---	---	---	---	---	---	---	---	---	----	----	----	----


- (A) 1. 0–10V styresignal Tilsluttes CTS602/700 print, Udgang A3
- (B) 2. Forsyning
- (C) 3. Lus monteres
- (E) 4. T7 skal monteres EFTER suppleringsvarme. Evt. i kanal.
- (E) 5. Den originale T7 føler afmonteres og erstatts med den medsendte

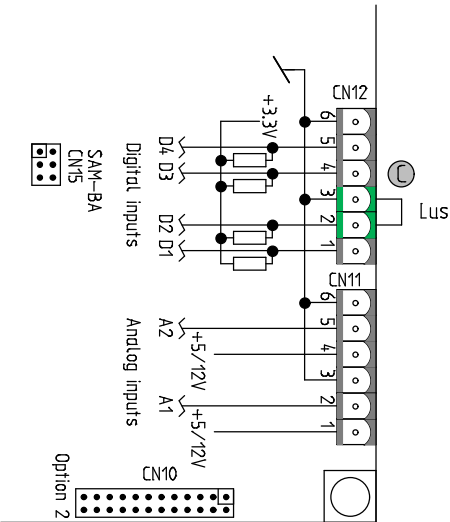

#764139 600W
 #764140 1200W
 #764149 2000W
 1x230V~ 50Hz max. 13A
 #764141 3000W
 #764145 3000W
 1x230V~ 50Hz max. 16A

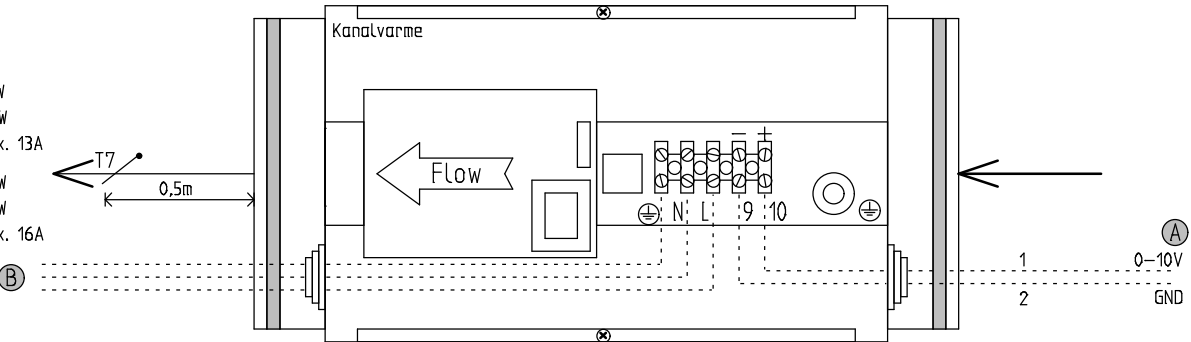

#764142 3000W
 2x400V~ 50Hz max. 16A

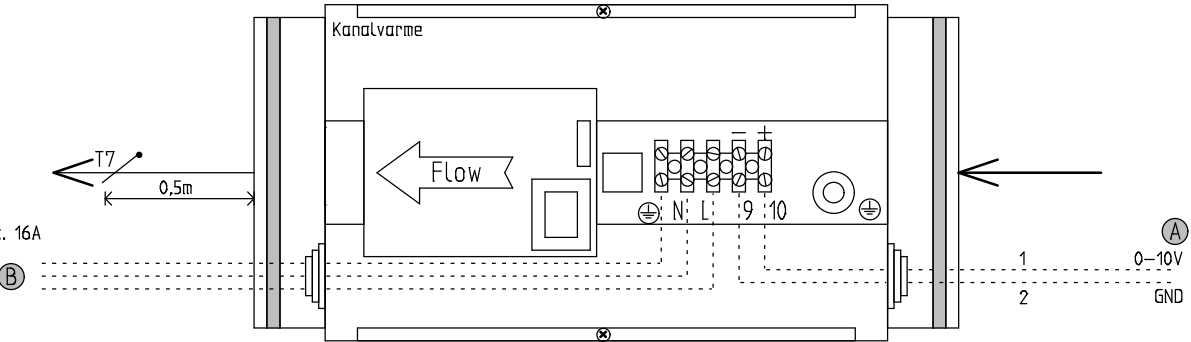

NILAN A/S
 Nilanvej 2
 DK-8722 Hedensted
 Tlf. +4576752500
 Fax +4576752525
<http://www.nilan.dk>
 Email : nilan@nilan.dk

EL-supplering
 Varenr. 764139 40 41 42 45 & 49

EL Suppleringsvarme
 Villa anlæg

Ordrenr.	Revision	Initialer
Dato	Nationalitet	Side
19/04-2018	DK / N / S / SF	1

Produktliste

[illegible]

EL-supplering

Varenr. 764139 40 41 42 45 & 49

Projekt

764139 40 41 42 45 49 V1-02 180419

	Dato
--	------

19-04-2018

	Land
--	------

DK / N / S / SF

Næste side

Antal sider

1

Side	
------	--

1